



# Monitoring at Holyrood Park Lodge between 19/12/2019 - 21/01/2020

● VOC ppb ● CO2 ppm

A event with 20 people over two hours. The levels are still under the 1000ppm often considered the highest acceptable CO<sub>2</sub> value.

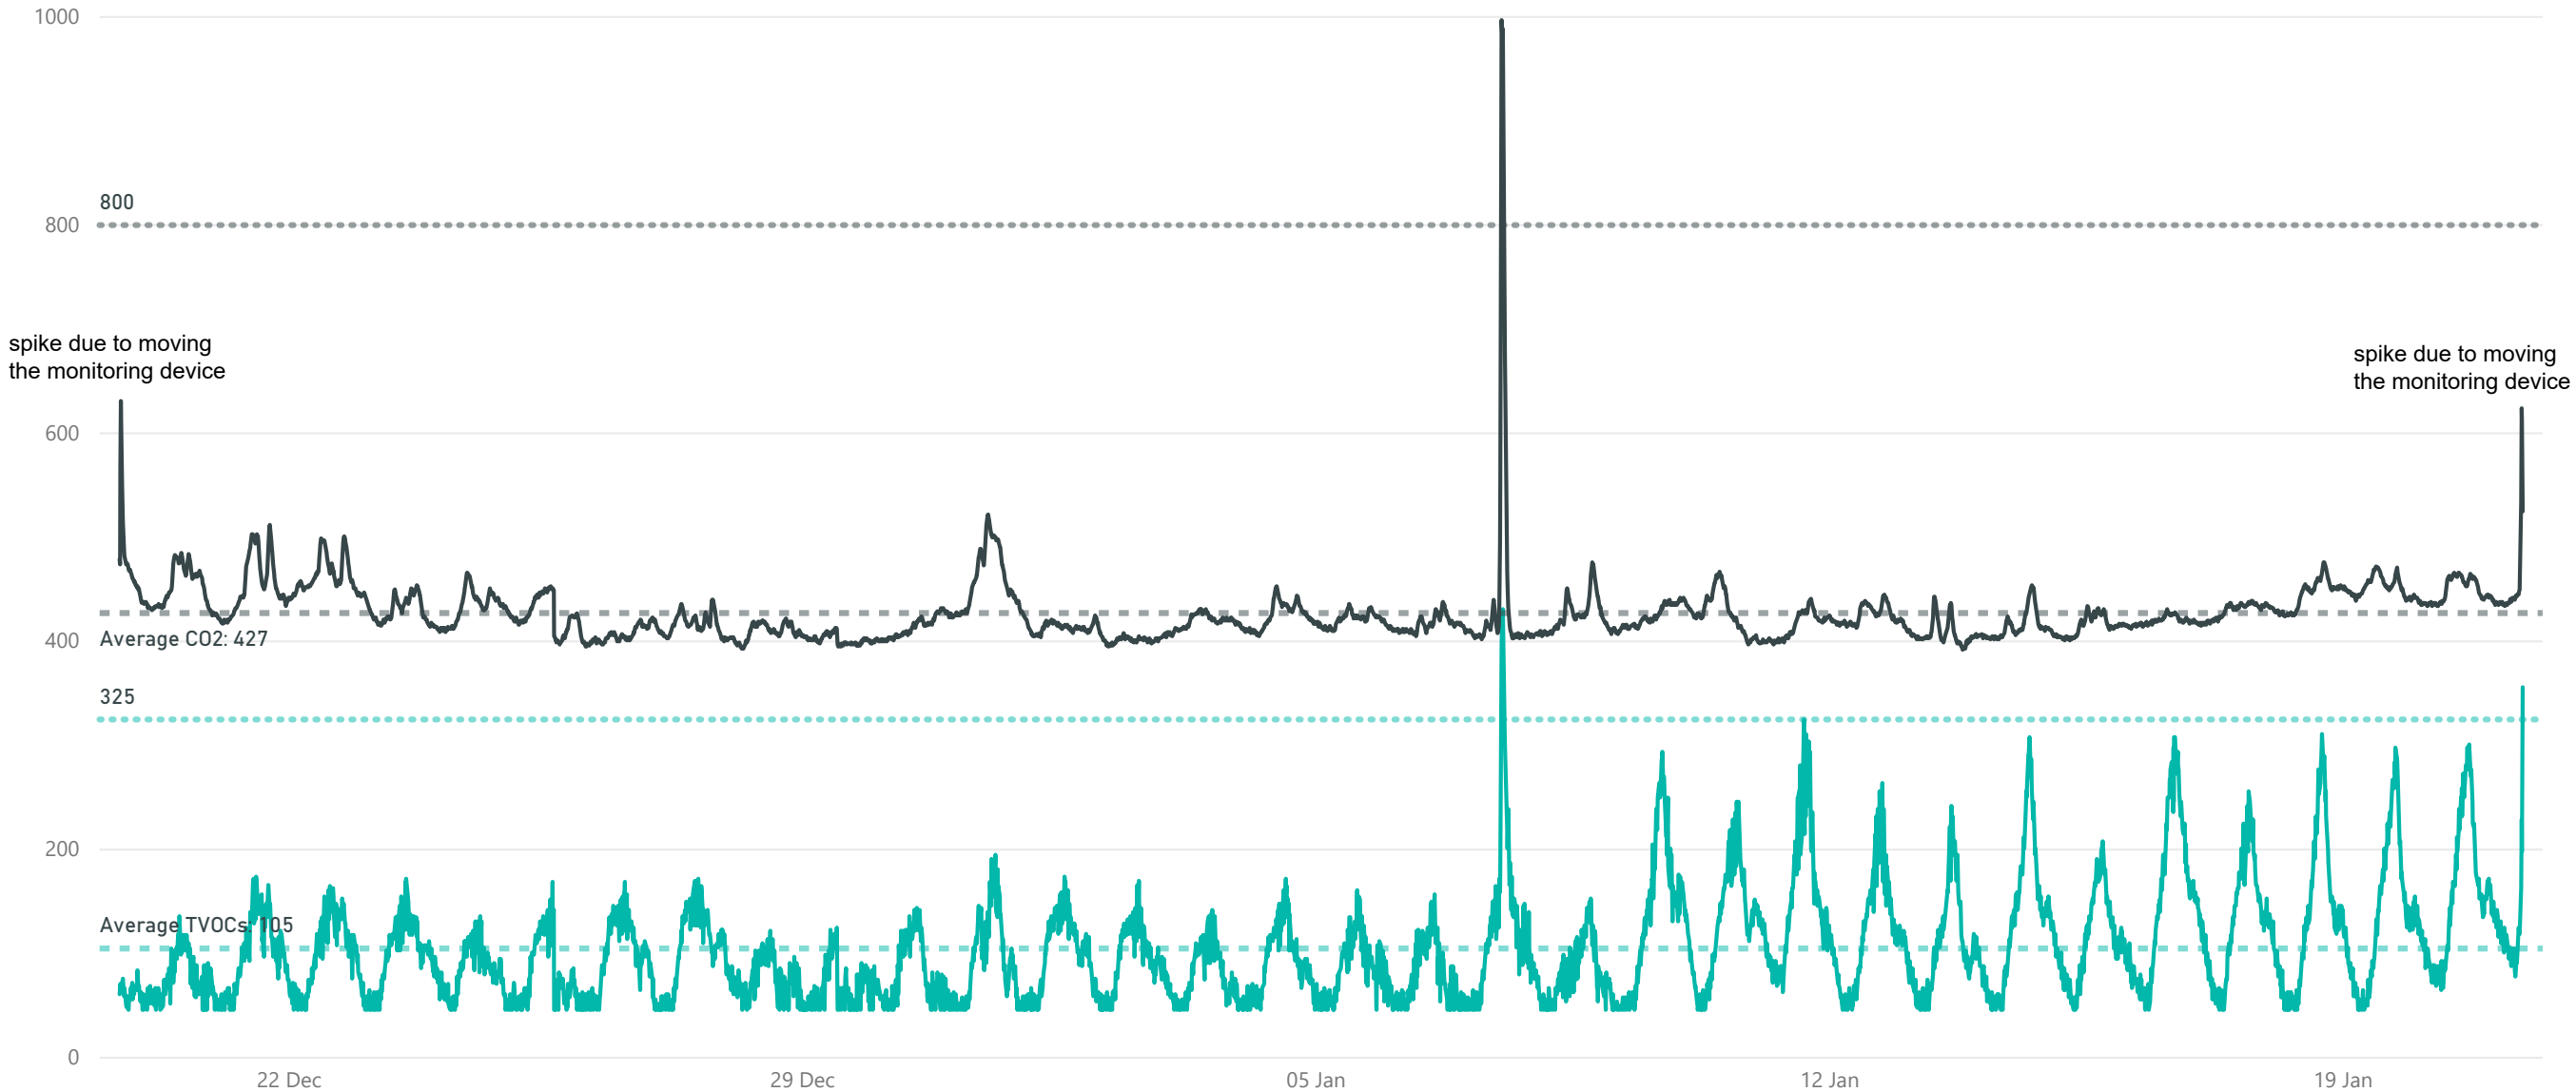

# Humidity

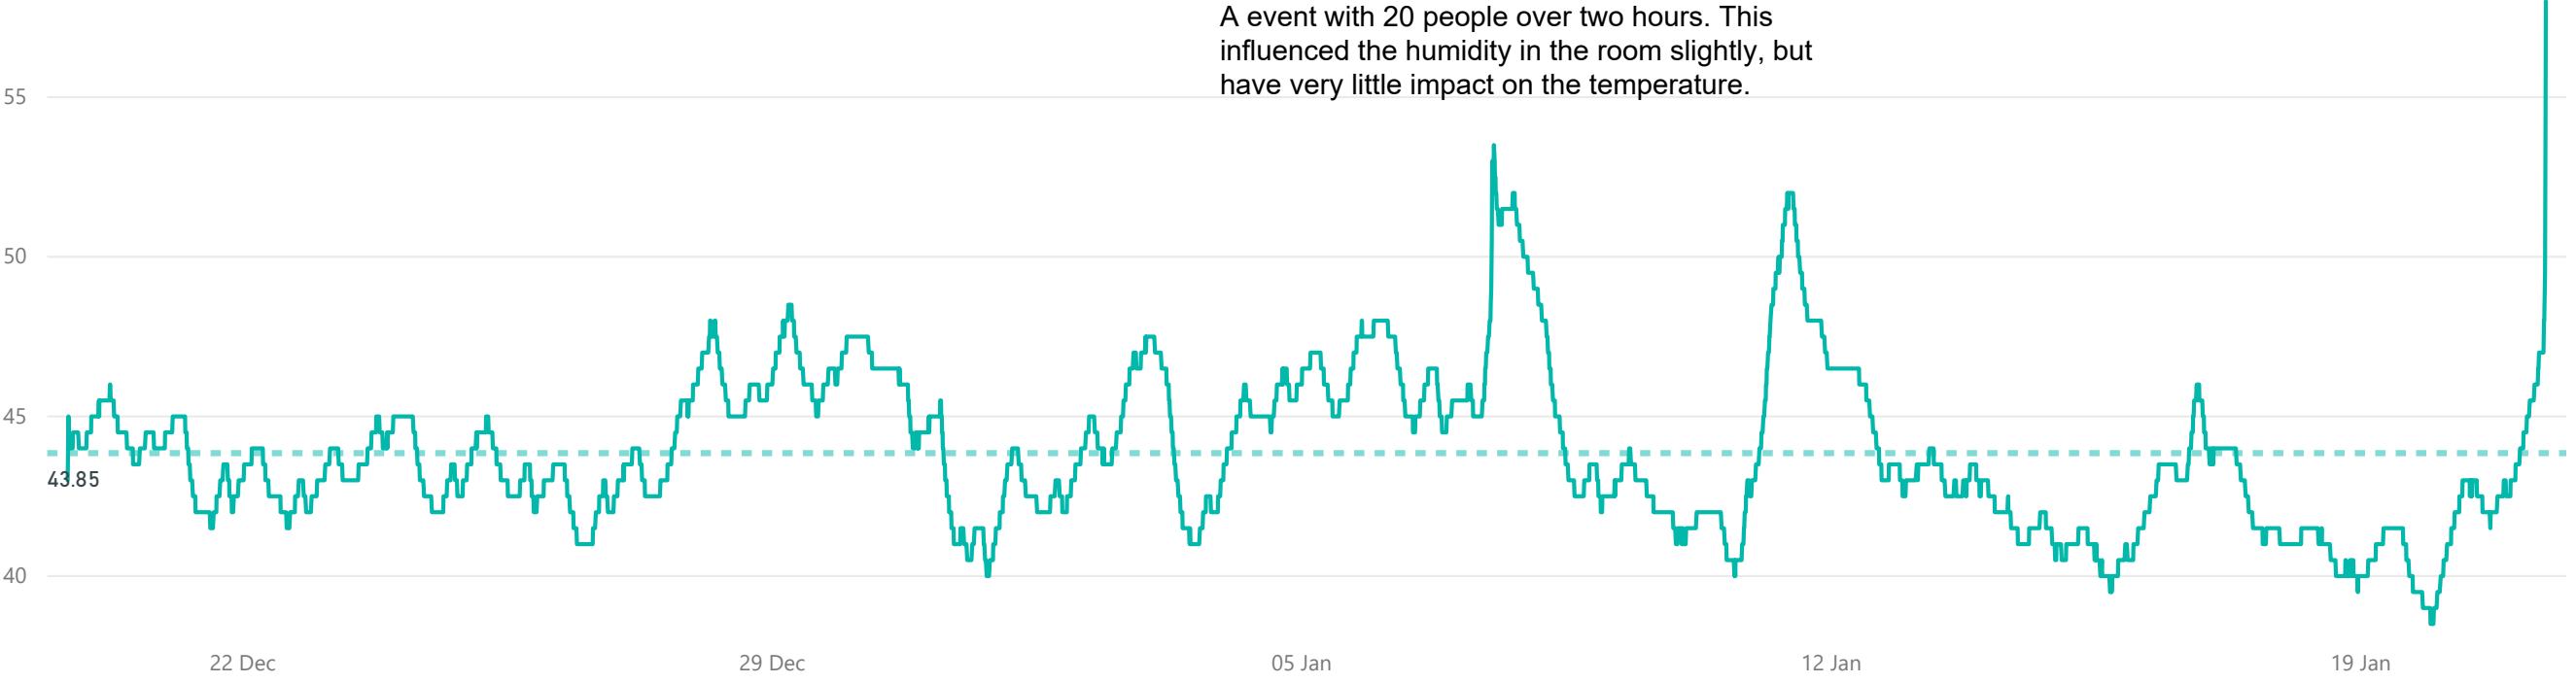

# Temperature

